





LIFTING MACHINE BY VACUUM TUBE
WILL RESULT IN SERIOUS DAMAGE

42 322 0010



NOTICE

Legal

Notice is hereby given that the undersigned has been appointed as the legal representative of the estate of the late [Name] deceased, and has accepted of the appointment.

Dated this [Date] day of [Month] 19[Year].

[Signature]

[Name]

[Address]

[City, State, Zip]

[illegible]



UPC-1200

Model: 1200
Serial: 12345678
Date: 12/12/2023
Manufacturer: ABC Corp.

V 100 2.5 2.0

COOLANT
OUT



VENT/PURGE
N₂ 15 PSI

GAS
5

GAS
4


GAS
3

GAS
2



GAS
1

CALIBRATION
DATA

MODEL: MPC-1000A
SN: C11-00000
MANUFACTURED BY: [illegible]



KEYBOARD

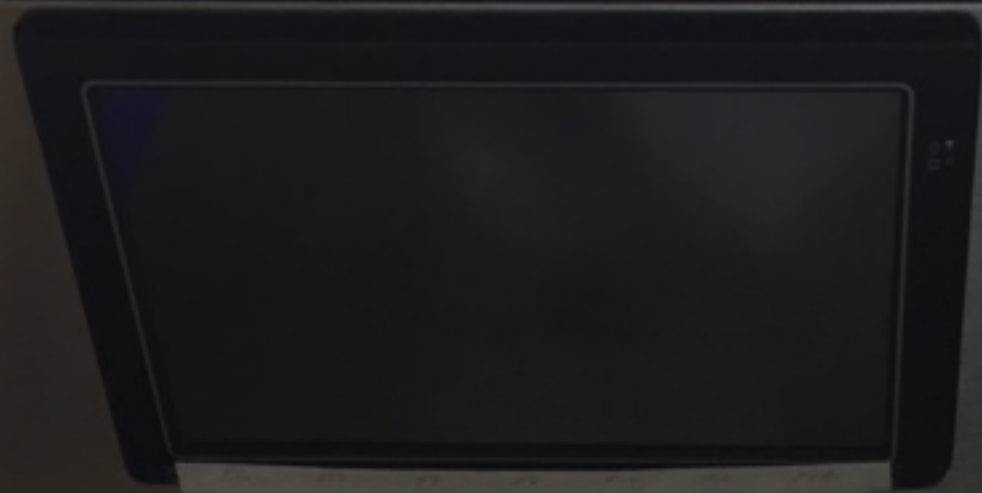

FRAN
PORT

OPEN



CLOSE

VENT VALVE

QUICK



RELEASE

ENABLE






RELEASE





PRESSURE
GAGE

LOW



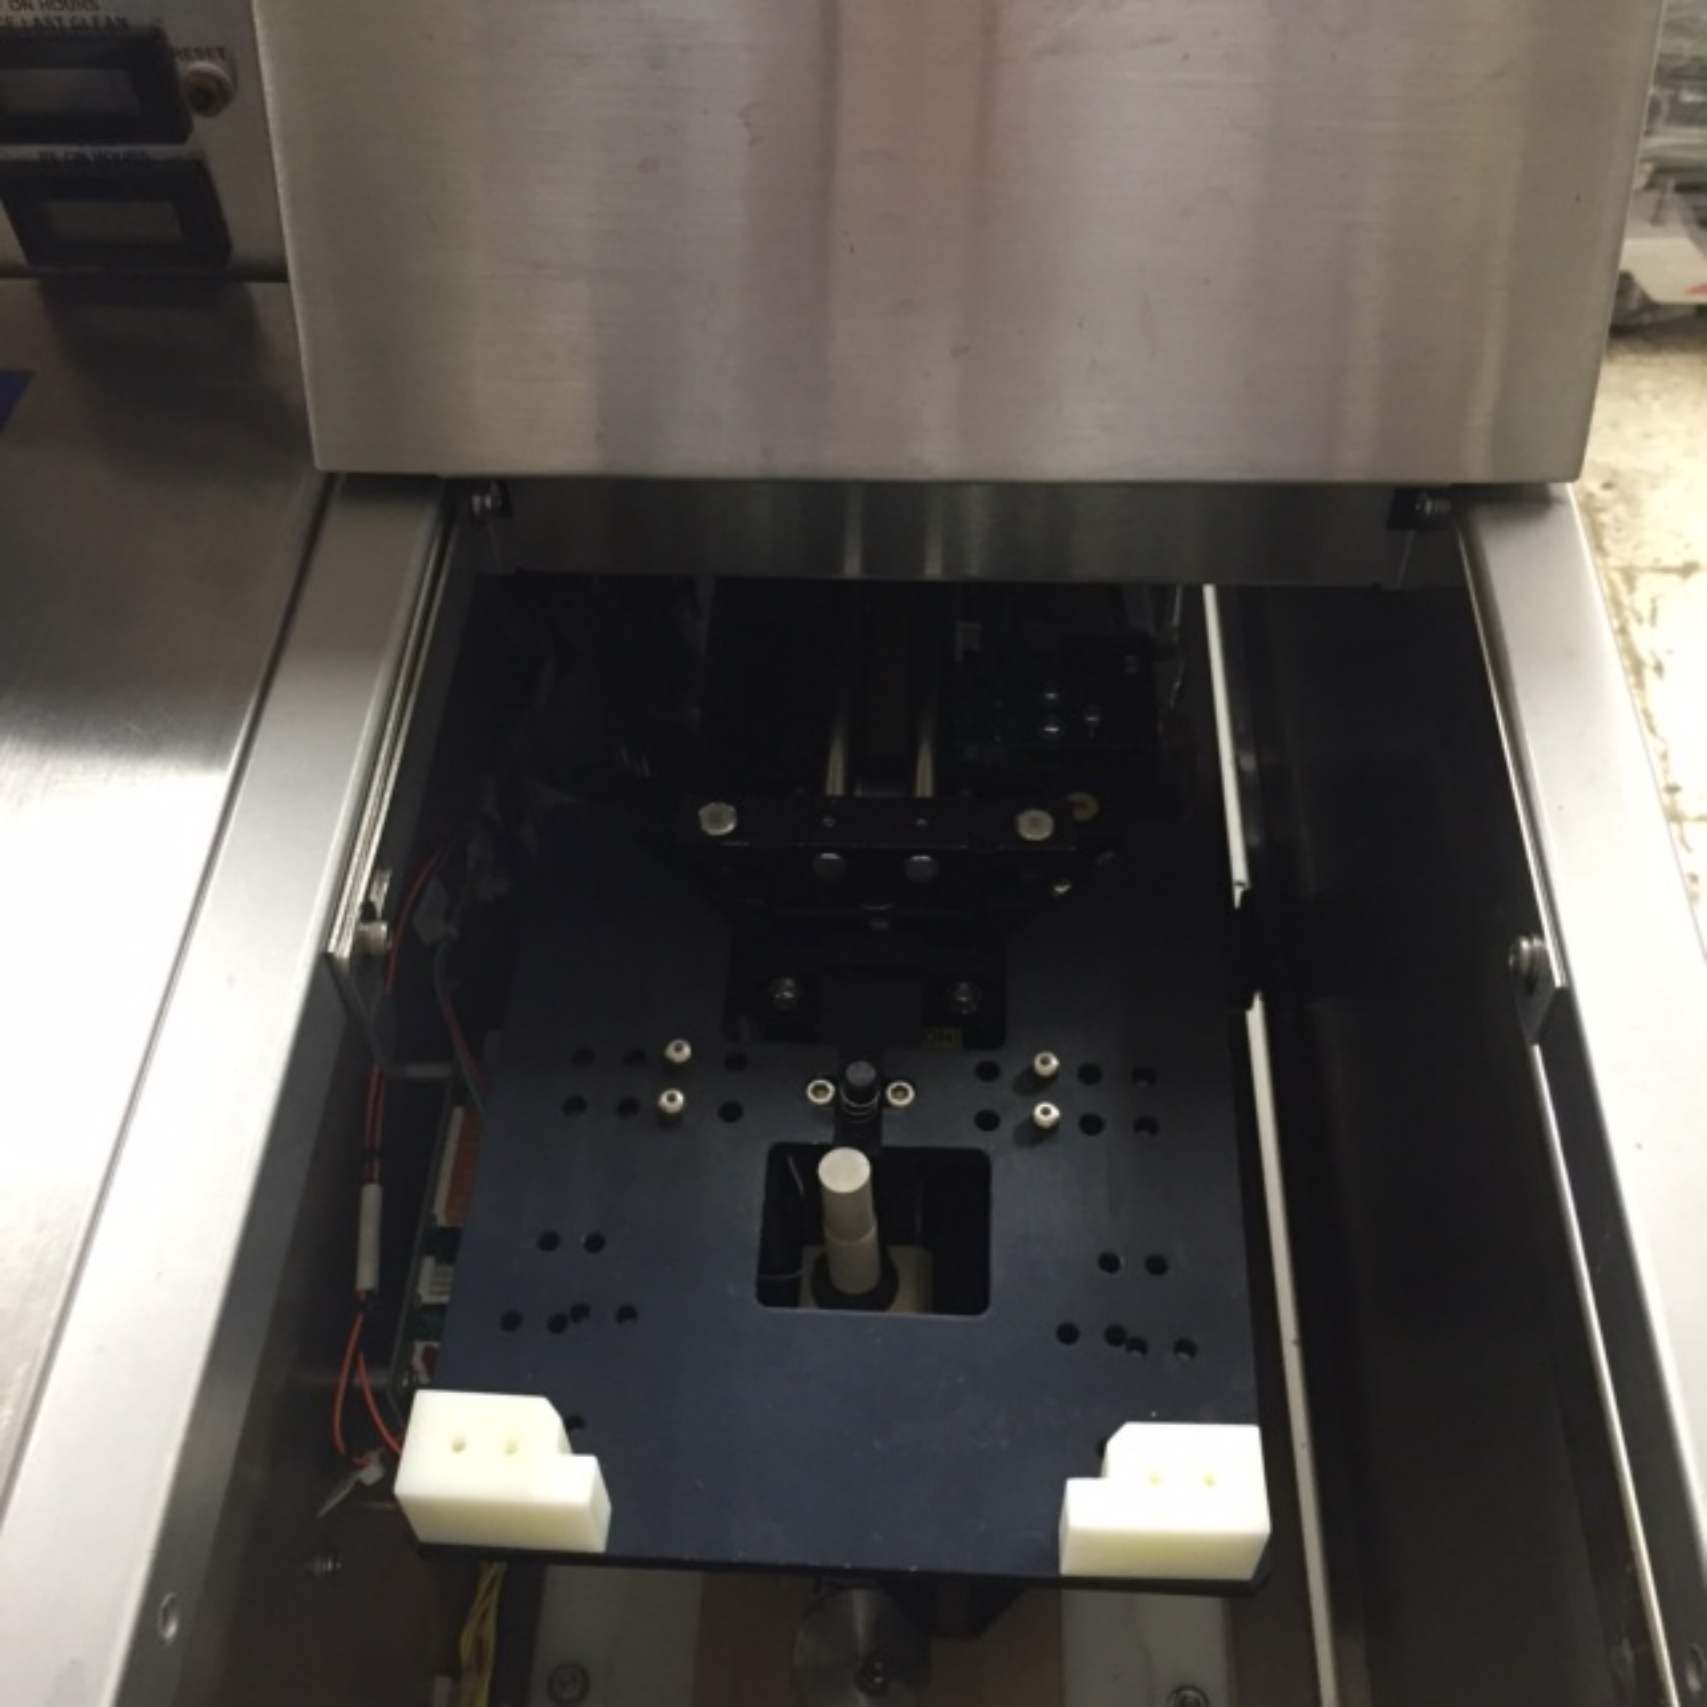

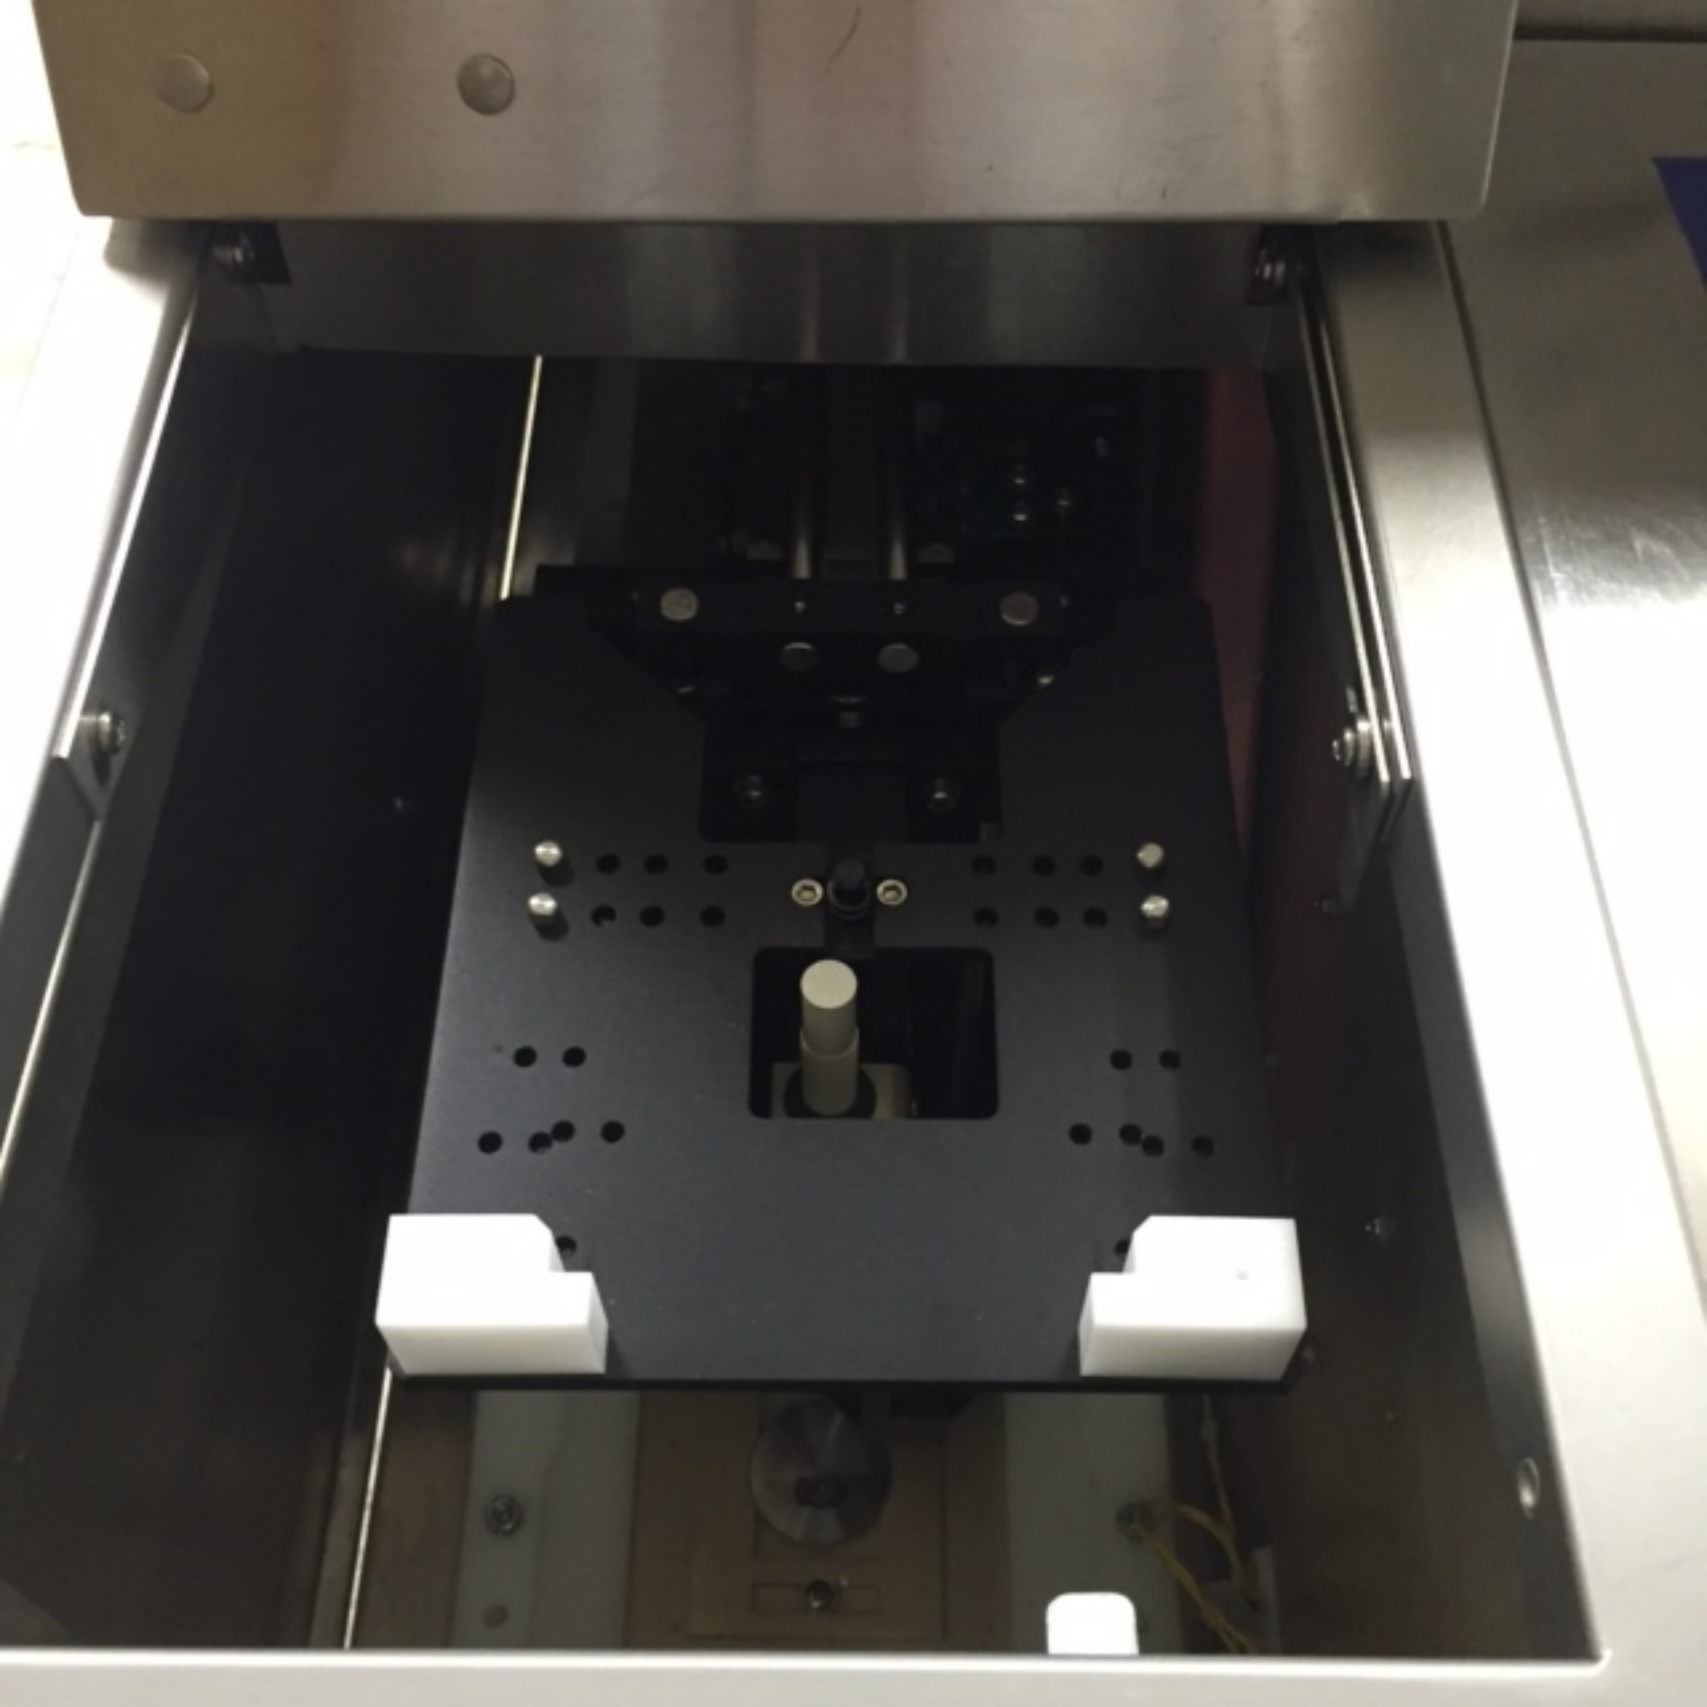

tegal 

PETALUMA,
CALIFORNIA
MADE IN USA

Item : CU9000-50153
S/N : CU50153
Volt : 200/208 VAC
Curr : 30 Amps
Phase: 1
Freq : 50/60 Hz
Wires: 2 + Ground
Mfg : 3/2000

teg

This eq
under o
followin

5,672,23
4,867,63
4,780,16
4,585,92
4,579,61

DANGER
HAZARDOUS AREA, TRAINED
SERVICE PERSONNEL ONLY

⚠ DANGER
RF may be exposed
if safety interlock
switches are
bypassed without
disabling AC to RF
generator



30 AMP	2 AMP	3 AMP	30 AMP	10 AMP
CB1	CB2	CB3	CB4	CB5
MAIN	CONTROL	DC	RF	HEATER

Switches: 1 (up), 2 (up), 3 (up), 4 (OFF), 5 (OFF), 6 (OFF), 7 (OFF)

END IN 1-2
END OUT 3-4


8

175 VAC 1 AMP

CB6
SERVICE


POWER REQUIREMENTS
208VAC 25A 1Ph 50/60 Hz
(2-Wire + GND)



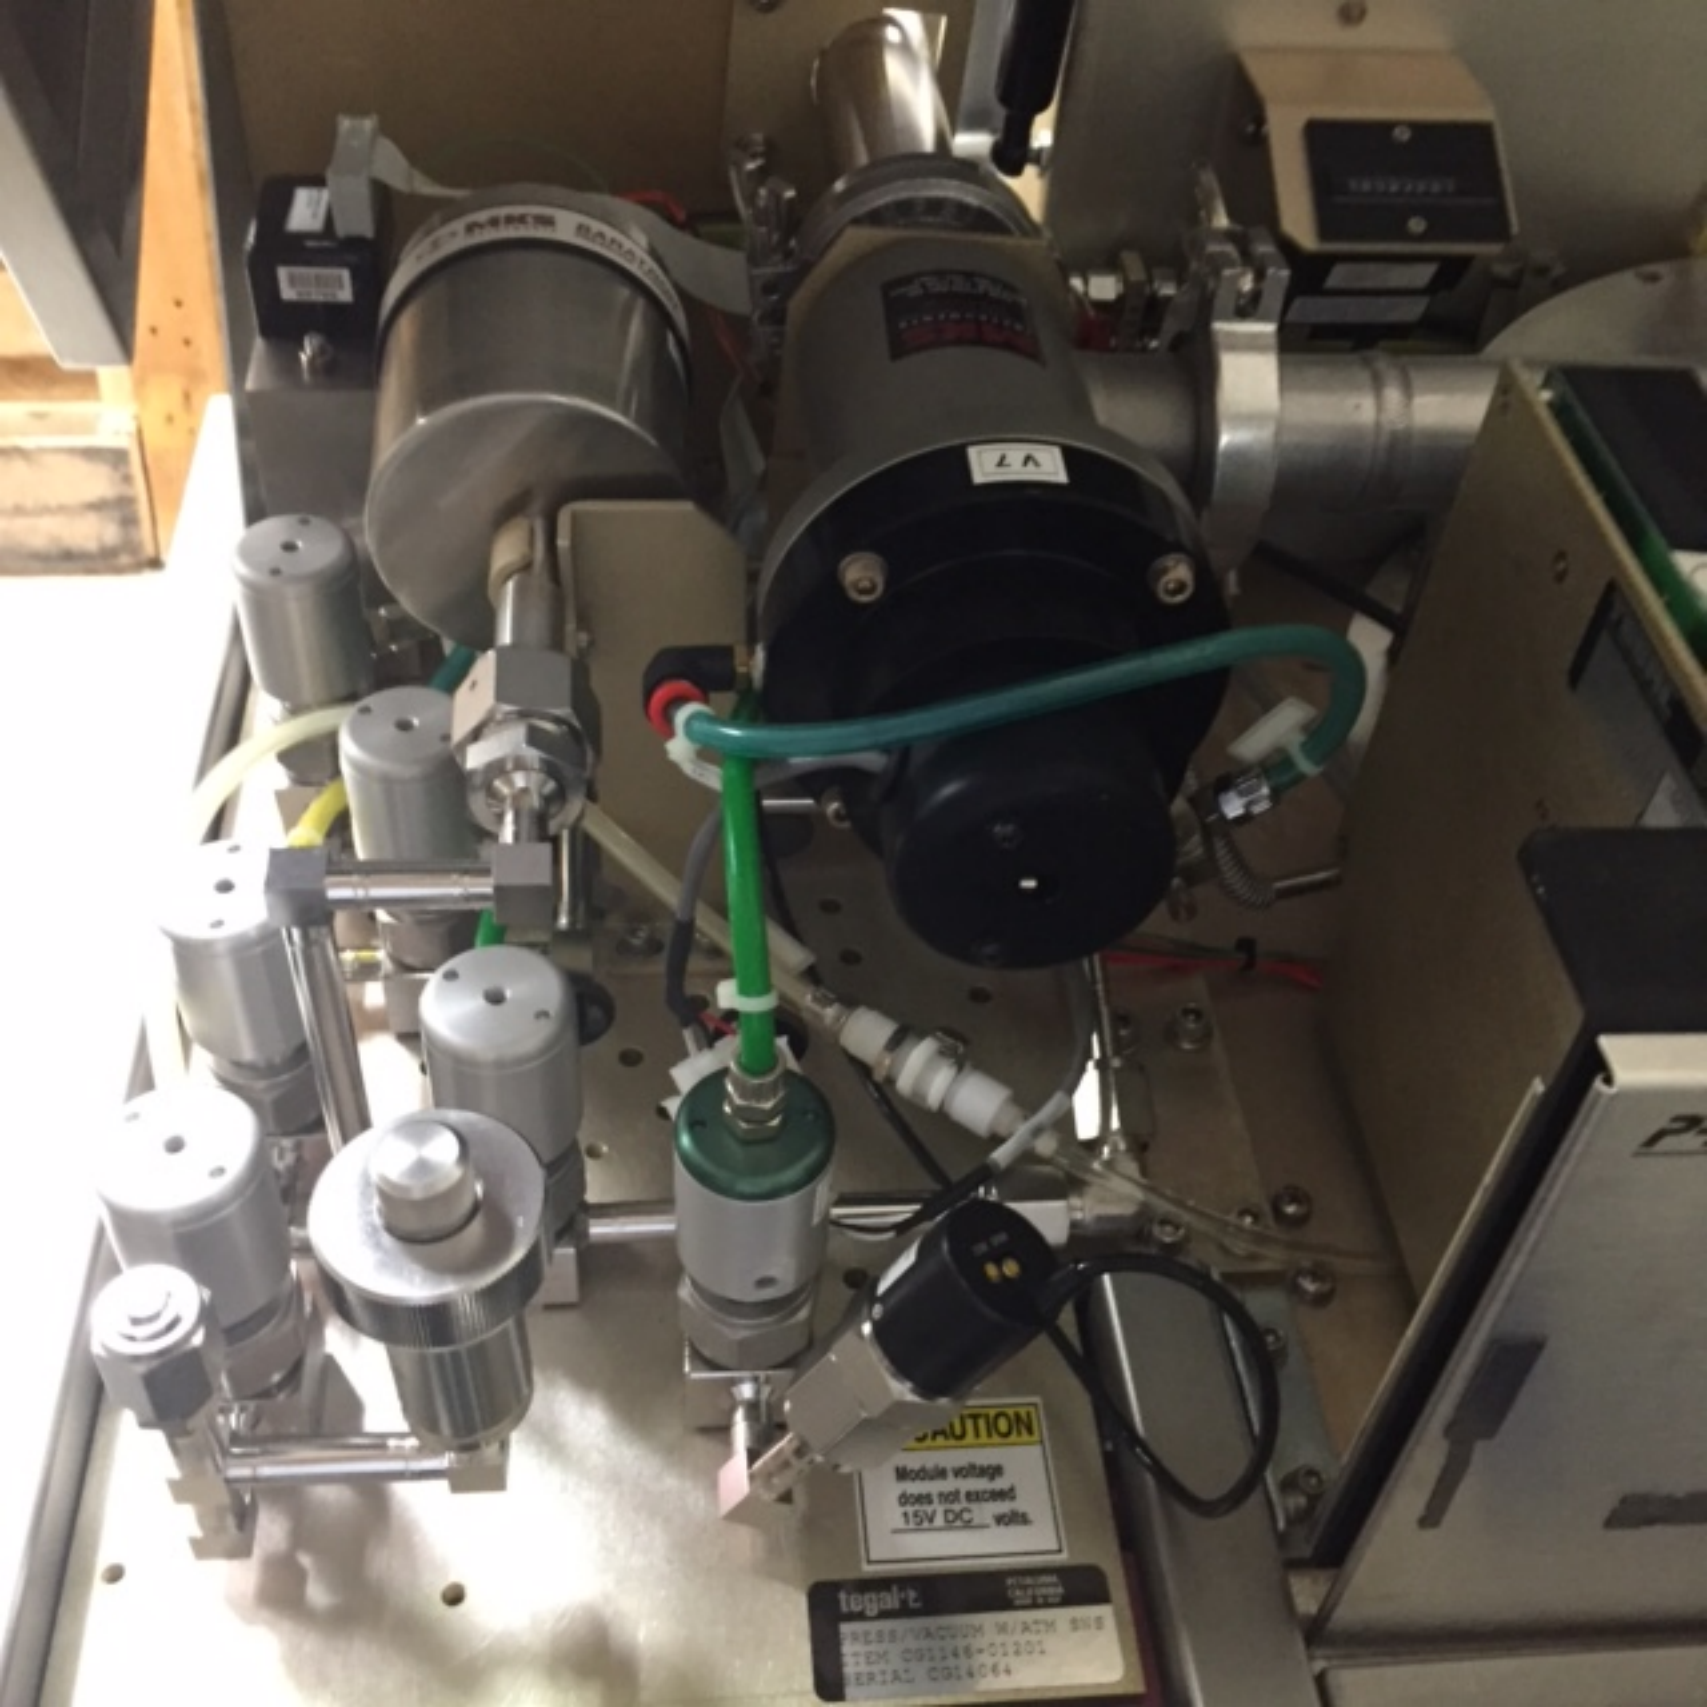


CAUTION
Module voltage
does not exceed
15V DC volts.

tegairt
PRESS/VACUUM W/ACH SNS
ITEM CG1346-01201
SERIAL CG14064

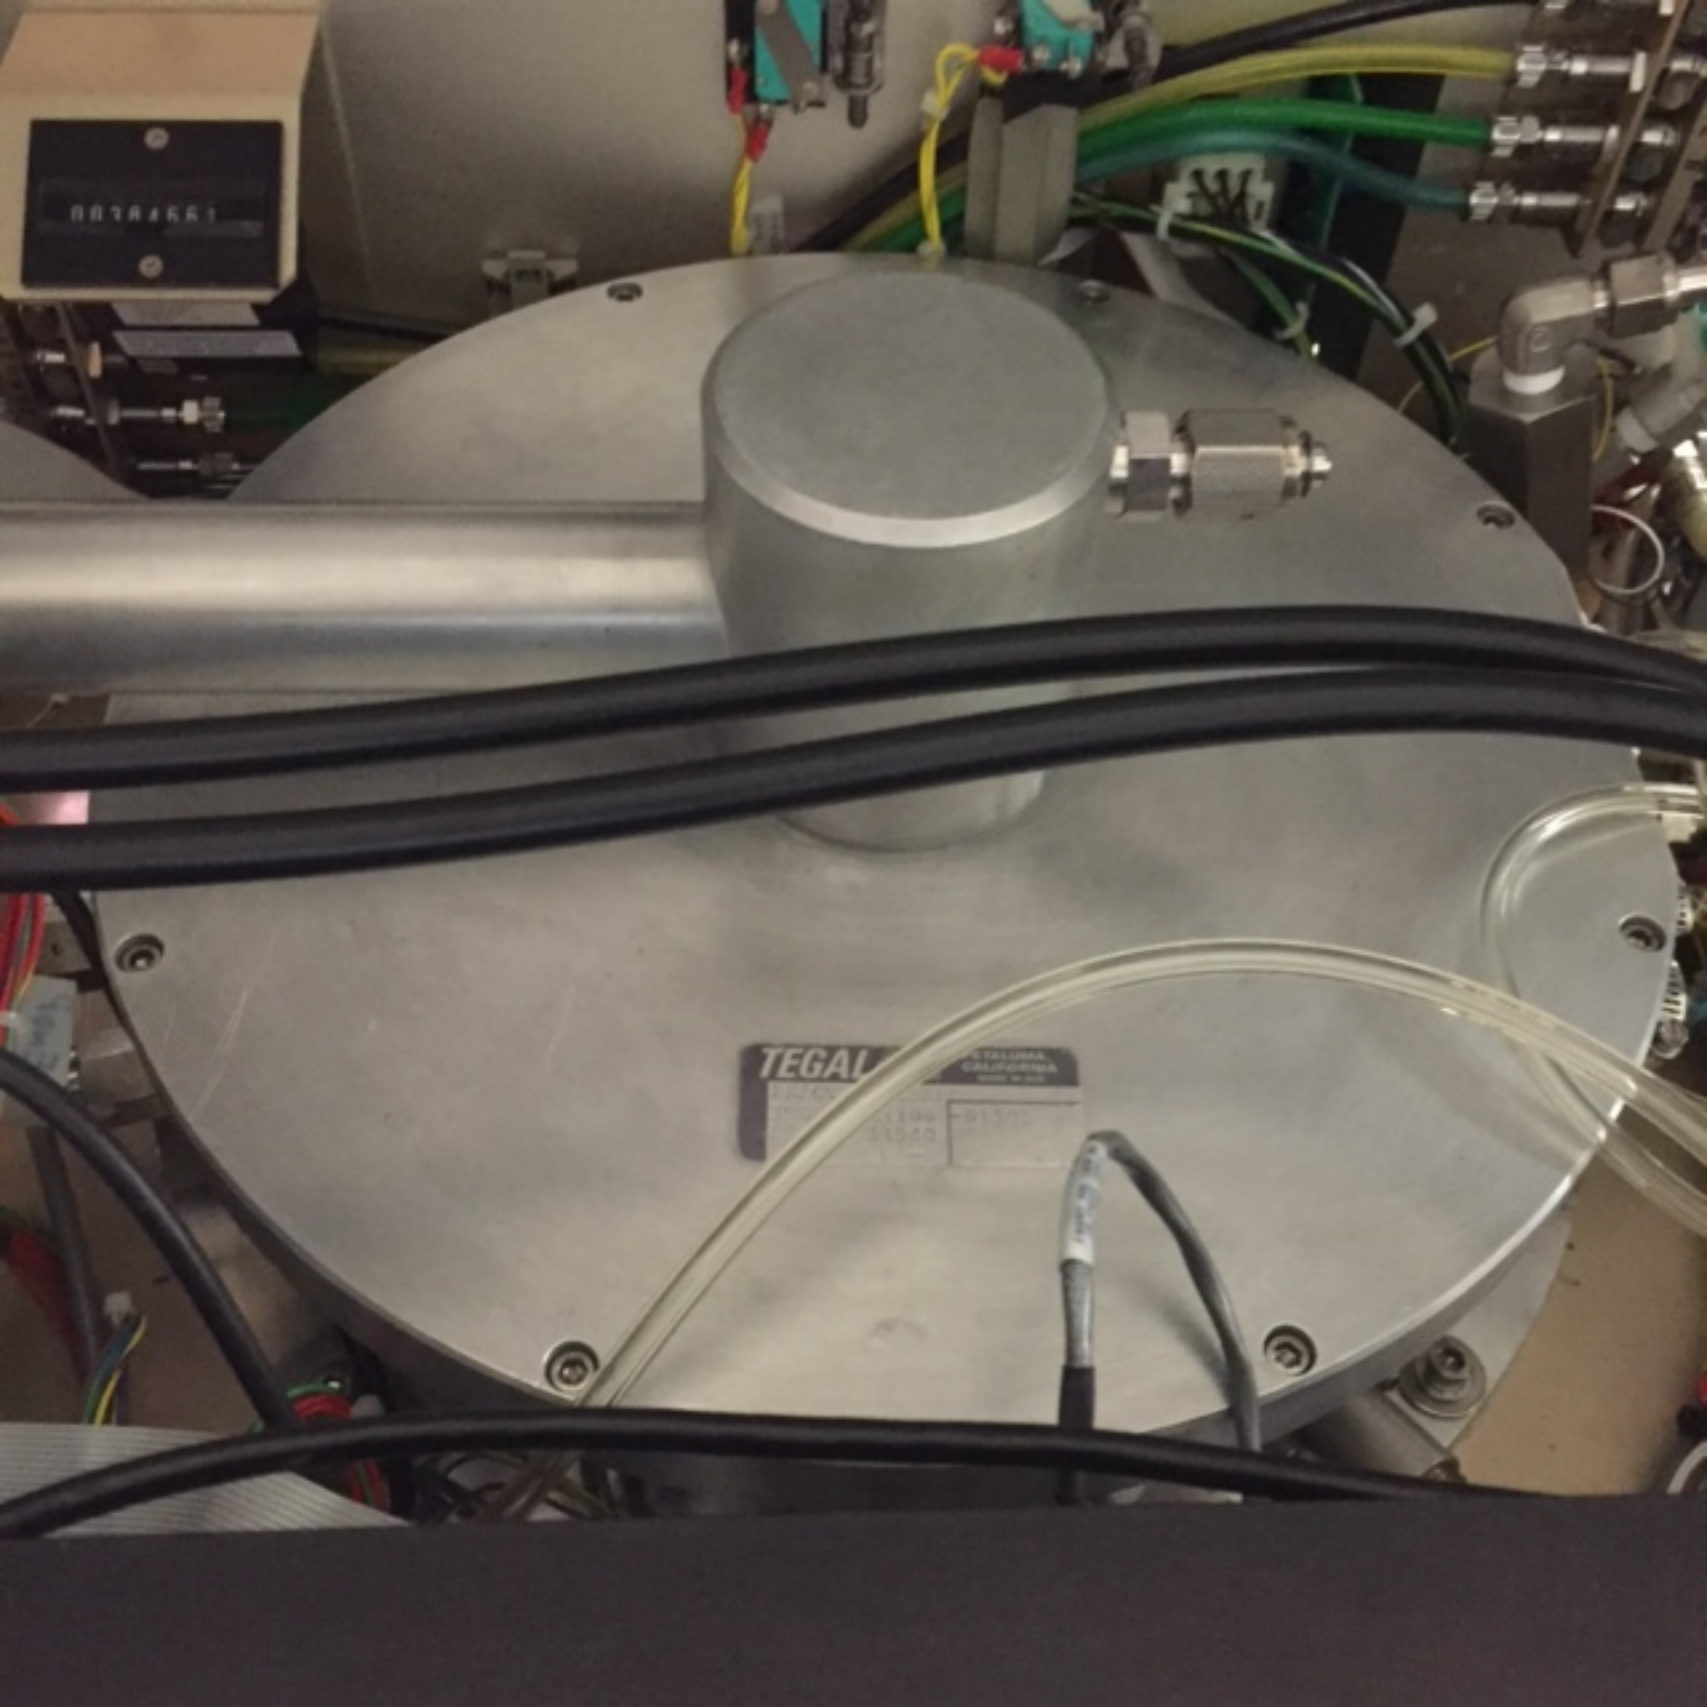

007A4551

TEGAL
TALLAHASSEE, CALIFORNIA
Model No. 100
1199-01302
11923

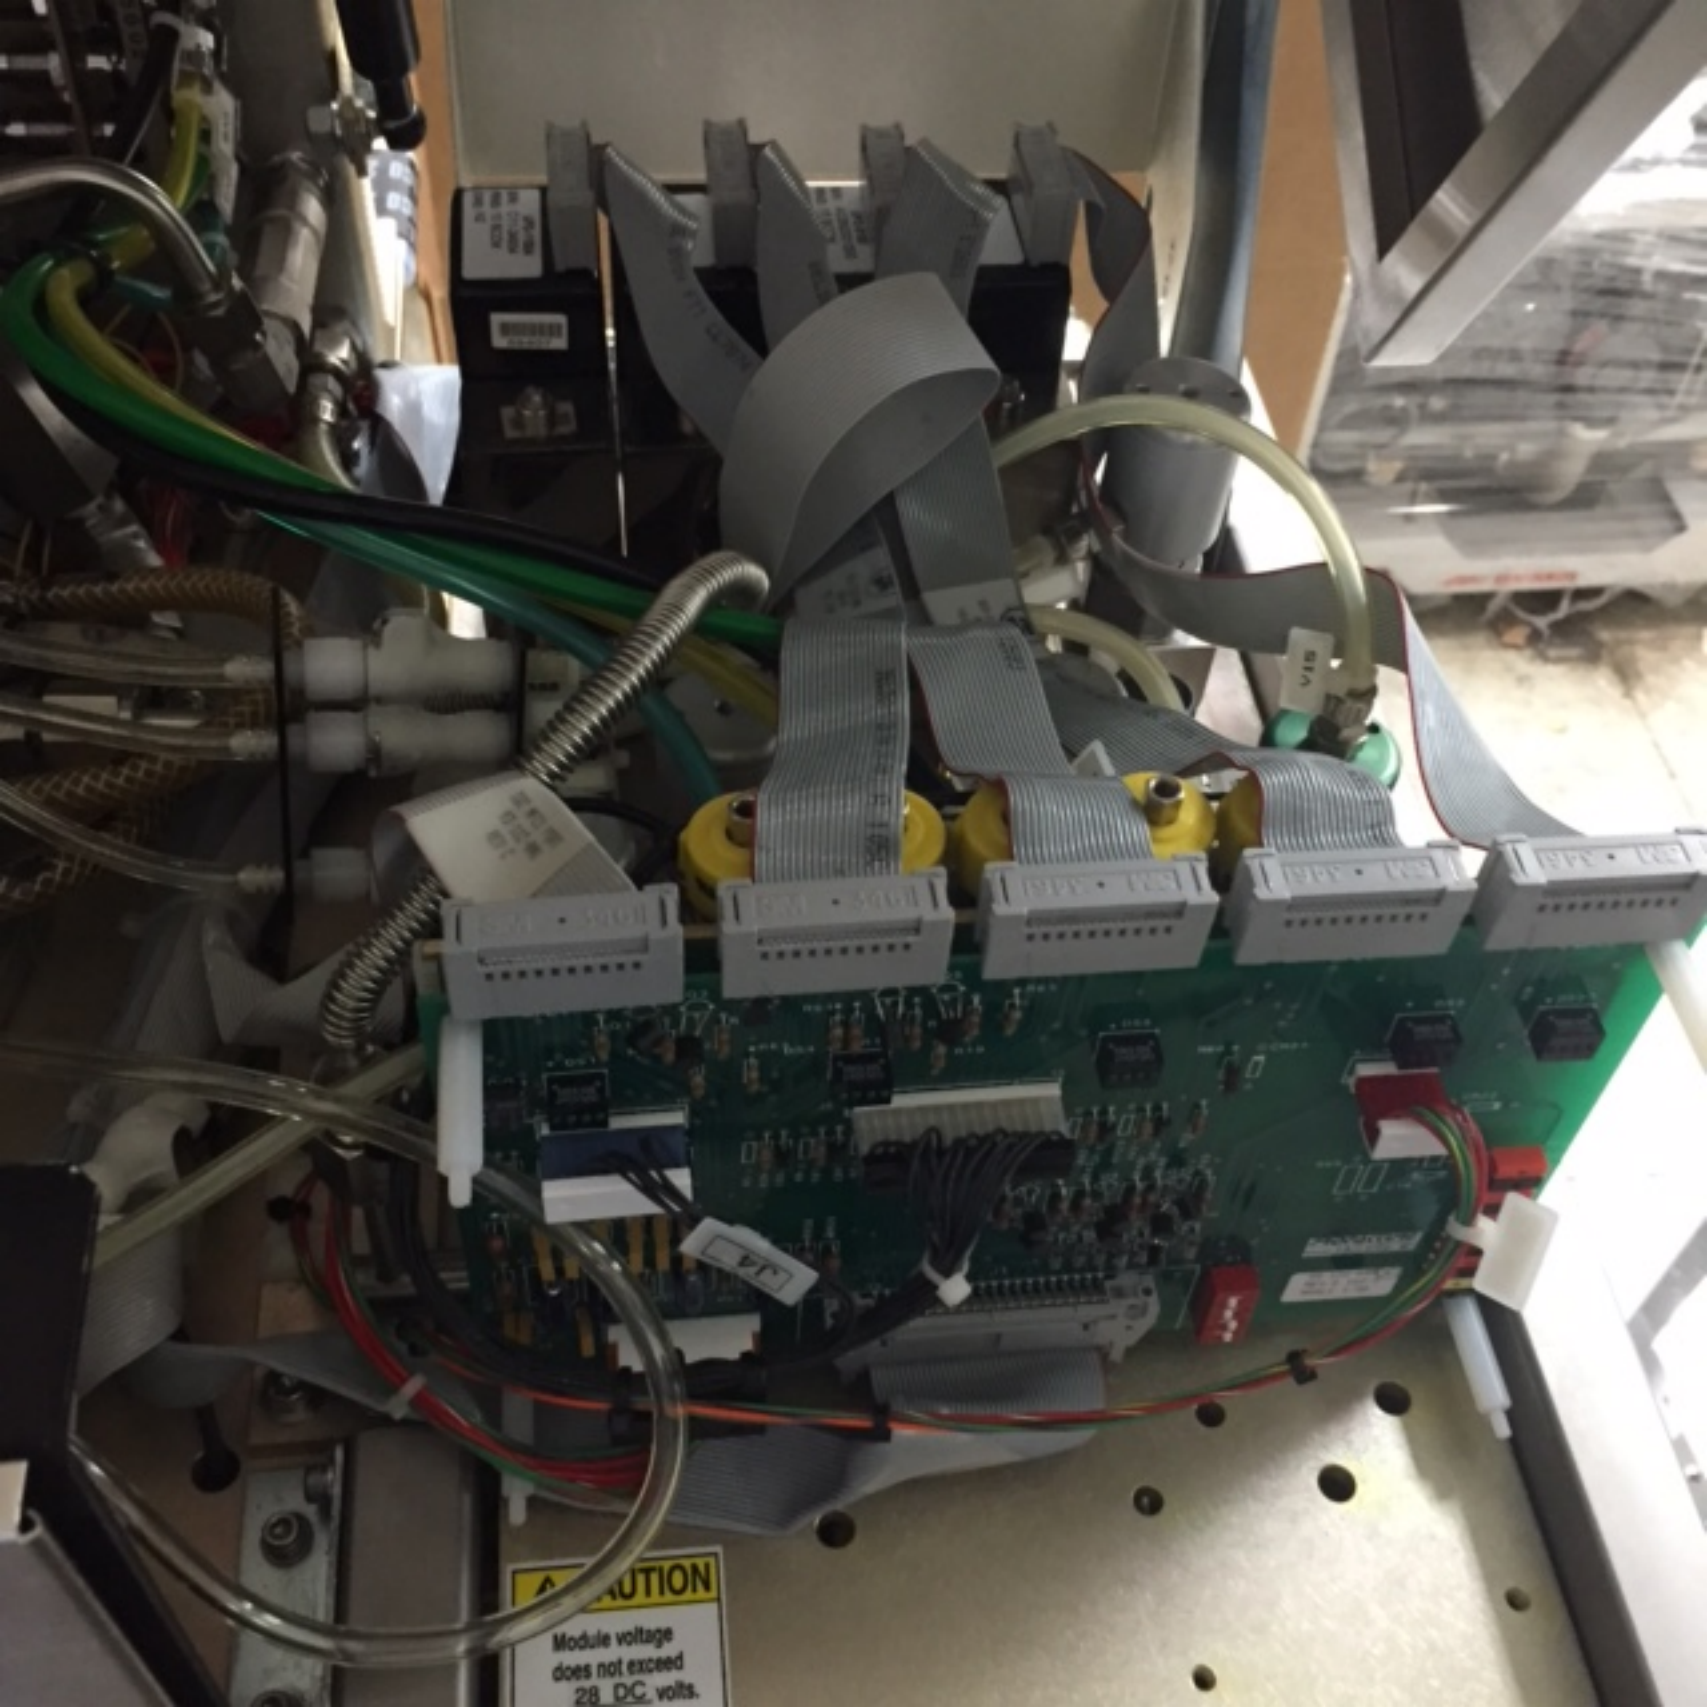

CAUTION
Module voltage
does not exceed
28 DC volts.



UFC-1100A
S/N: C11-34934
RNG: 10 SCCM
GAS: N2


UFC-8100
S/N: A0262001200
RNG: 15 SCCM
GAS: SF6

42 121 001

38-MC-06221102
2 SLW R2



3 000
784-111-111
1000 10000000



MKS
INSTRUMENTS

BARATRON
PRESSURE TRANSDUCERS

